


Range Safety Card

AFA G-2 59031 90037	Date Prepared 02 Jun 06	Impact Area Zulu Whiskey	Weapon 155mm	Charge 5 GB 4 WB	Projectile HE	Fuzes PD
--	--	---	------------------------	-------------------------------	-------------------------	--------------------

Pe Range 28/96/336				Pe Deflection 5/40		Max Rng	LLL
Target Box							
Min Range Target		Max Range Target		Dog Leg		7800	6130 mils
Left	Right	Left	Right	Min Rng	Max Rng	Min Rng	RLL
57594 95346	62920 93926	56993 97566	64546 95552	Na	Na		

Remarks							
Approved safety card data card, SDZ & signed ORM must be on hand to conduct training.							
Relief From Prohibition to Fire Over ASP from HQMC (dtd Aug 25, 2005) is in effect for this SDZ and Data Card.							
Max Ord (feet AGL):							
5G							
LowAngle - 4189							
High Angle - Will Not Be used							
4W							
Low Angle – 5629							
High Angle - Will Not Be used							

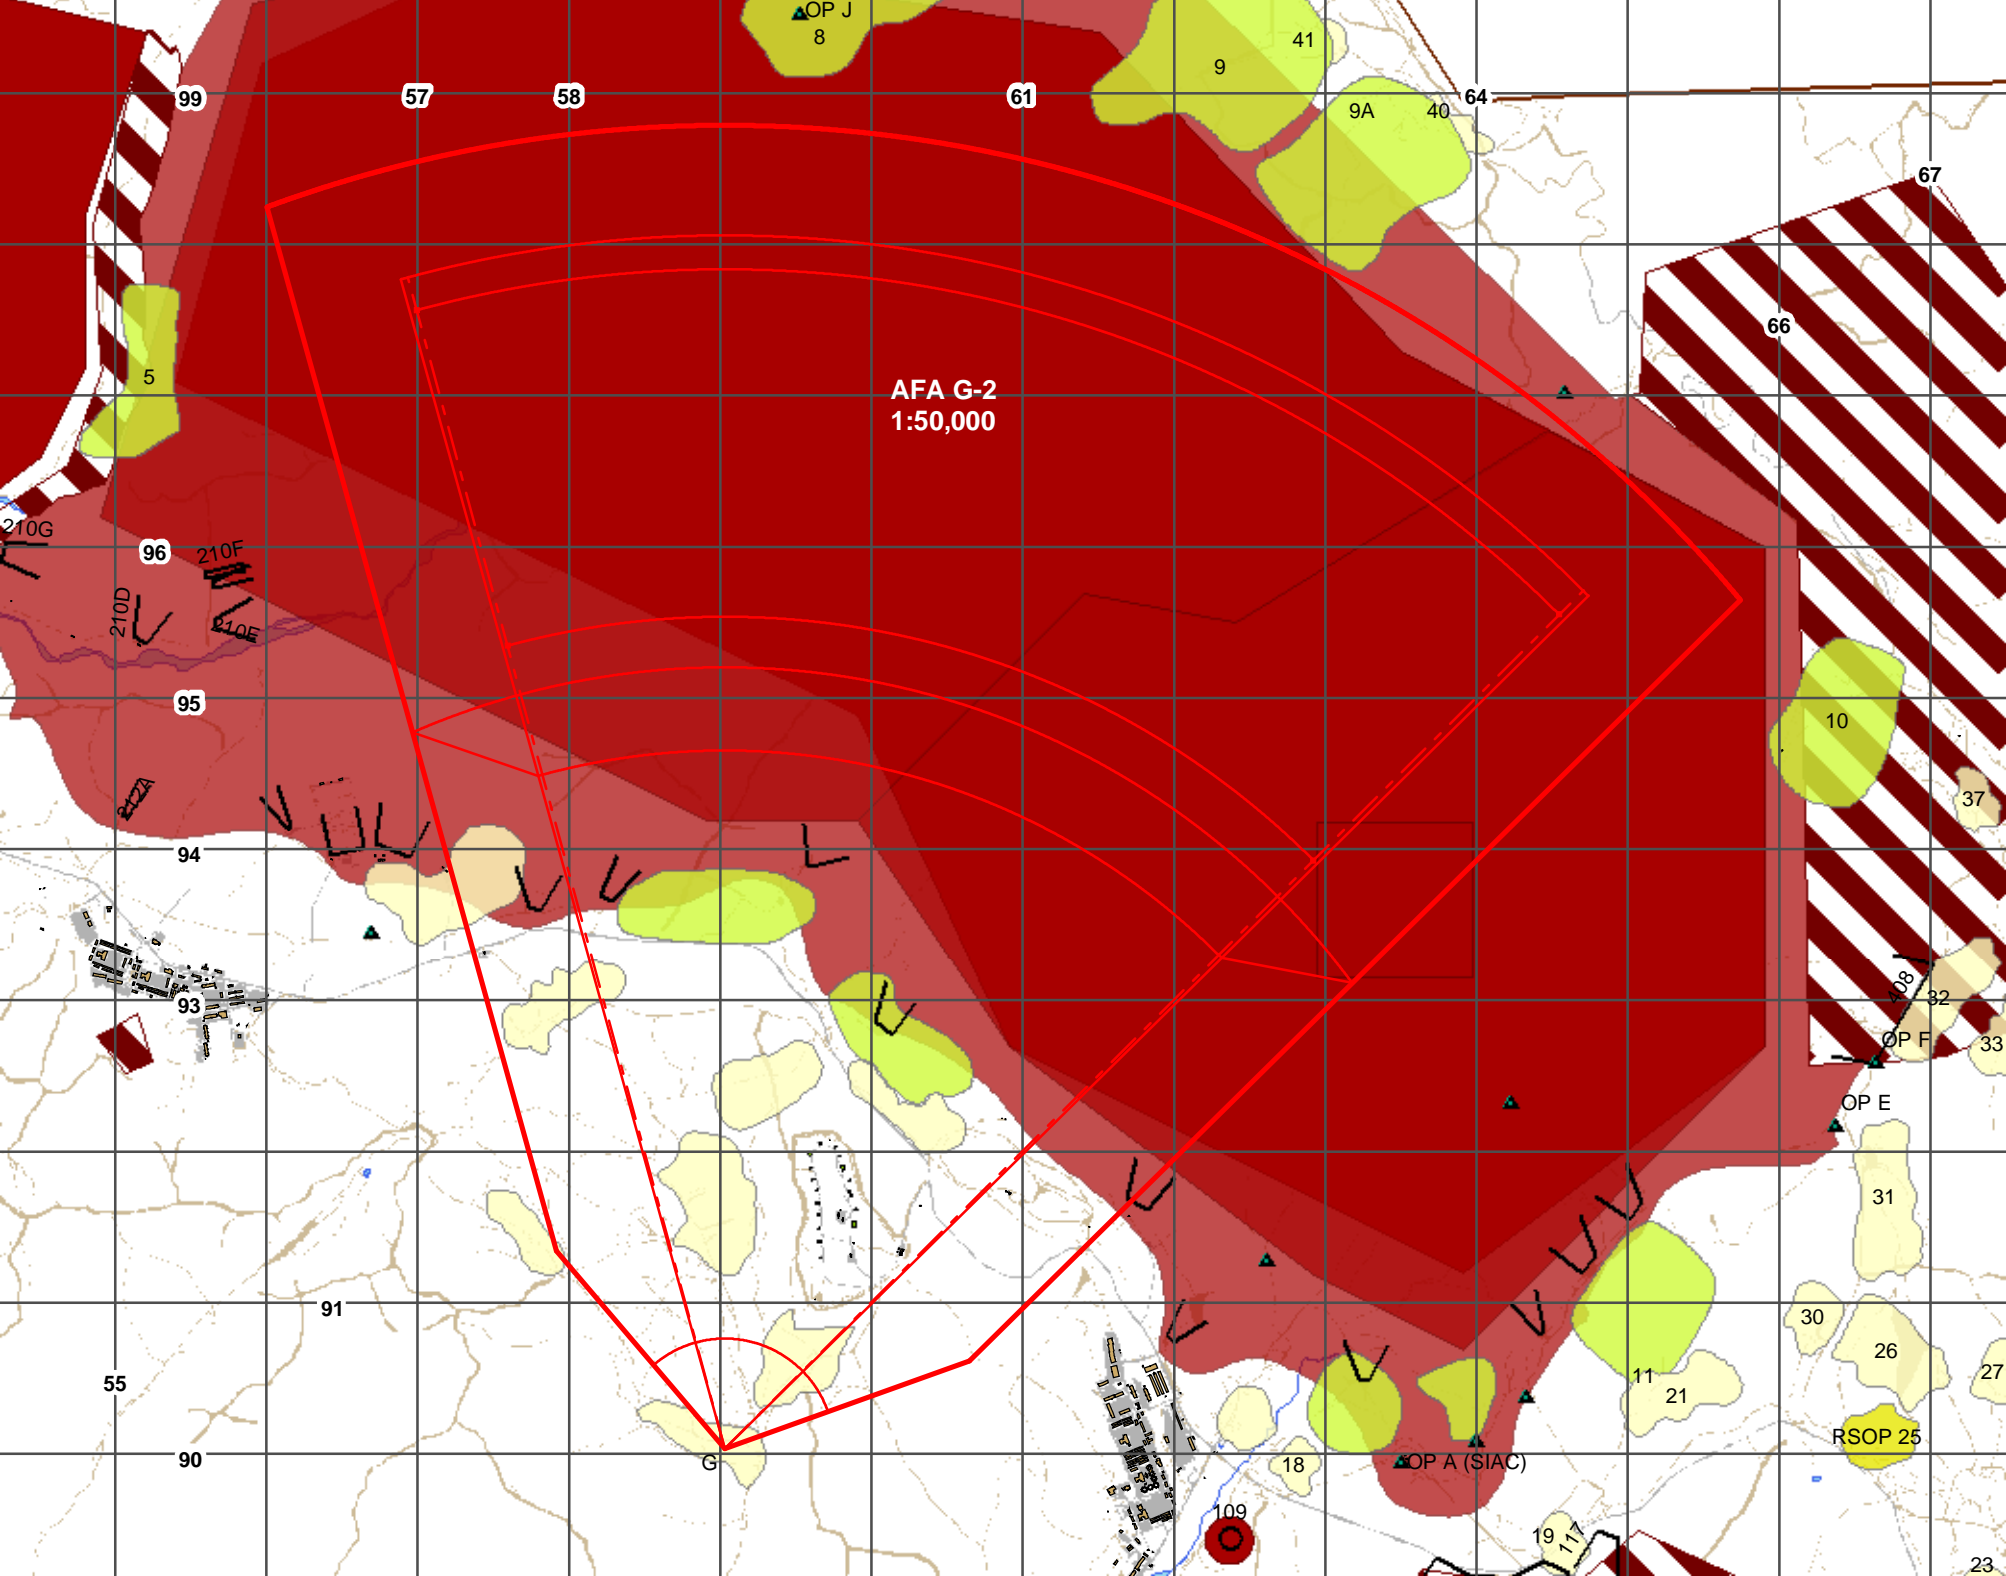

AFA G-2
1:50,000

G

OP A (SIAC)

OP E

OP F

OP G

OP J
8

9

41

9A

40

64

67

66

10

37

33

32

31

30

26

27

21

RSOP 25

23

18

19

117

109

91

94

95

96

99

57

58

61

8

9

41

9A

40

64

67

66

10

37

33

32

31

30

26

27

21

RSOP 25

23

18

19

117

109

91

94

95

96

99

57

58

61

8

9

41

9A

40

64

67

66

10

37

33

32

31

30

26

27

21

RSOP 25

23



DEPARTMENT OF THE NAVY
HEADQUARTERS UNITED STATES MARINE CORPS
3300 RUSSELL ROAD
QUANTICO, VIRGINIA 22134-5135

IN REPLY REFER TO:


3570
C 465
AUG 25 2005

From: Commandant of the Marine Corps
To: Commanding General, Marine Corps Base, Camp Pendleton
Via: Commander, U.S. Marine Corps Forces, Pacific/Commander, Marine Corps Bases, Pacific

Subj: RELIEF FROM PROHIBITION TO FIRE OVER THE 43 AREA AMMUNITION
SUPPLY POINT AND FIELD AMMUNITION SUPPLY POINTS

Ref: (a) MCO 3570.1B
(b) DA pamphlet 385-63
(c) MCO 3500.27A

1. Your request for artillery fire over the 43 Area ASP and field ASPs is approved for a period of one year from the date of this correspondence.
2. Paragraph 2-5a of reference (a) establishes the Commandant of the Marine Corps as approval authority for exceptional range safety circumstances that are not to be delegated to normal deviation authorities. Firing over ASPs is included in this paragraph. Paragraph 1-4e of reference (a) establishes the Commanding General, Marine Corps Combat Development Command as the Marine Corps range and training area safety representative.
3. While routine firing over ASPs is prohibited, the graphic depictions of the surface danger zones (SDZs) firing from Artillery Fire Areas 12, 14, 15, and G show the ASP to be located within Area D in all cases.
4. Reference (b), paragraph 11-4k states: "...Area D is the "safe zone" within the SDZ where minimal hazards exist, provided certified ammunition for overhead fire is used..." Accordingly, I trust you will ensure that:
 - a. Only ammunition certified for overhead fire is used.
 - b. Any field ASPs are contained within the 43 Area ASP boundaries.
 - c. A detailed operational risk management assessment is accomplished per reference (c).
 - d. At no time will the ASP be located in any portion of the SDZ except Area D during firing.
 - e. You adhere to all other installation range safety standards and artillery firing/safety procedures.
5. The point of contact at this headquarters is Mr. Jack Cuddy, Director, Range and Training Area Management Division, at (703) 784-4548 or DSN 278-4548.


J. N. MATTIS
By direction